




# Tests & Certificates



Certified by German  
Institut für Elektrophotonik (Berlin)



[www.elektrophotonik-berlin.de](http://www.elektrophotonik-berlin.de)

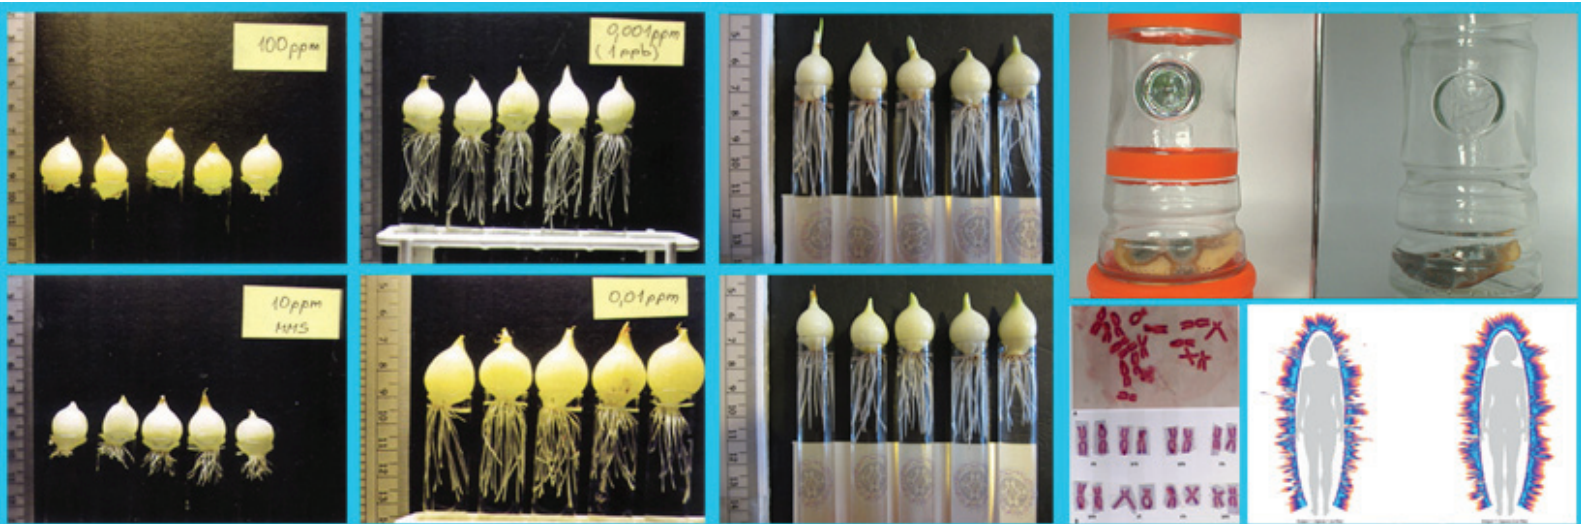

## Allium Tests

Laboratory of plant cytogenetics

Following the results of general toxicity and genotoxicity level between positive and negative control treated tap water (original i9 informed water bottle) has a lower genotoxicity level than ordinary tap water.

Treatment in accordance with original technology (original i9 informed water bottle) reduces the level of general toxicity as well as the level of genotoxicity ( $p = 0,0325 < 0,05$  – Fisher's Exact Test). The quality of water is improved.

[www.i9bottle.com](http://www.i9bottle.com)